


Farm APSA and SPCC Plan Requirements Flow Chart

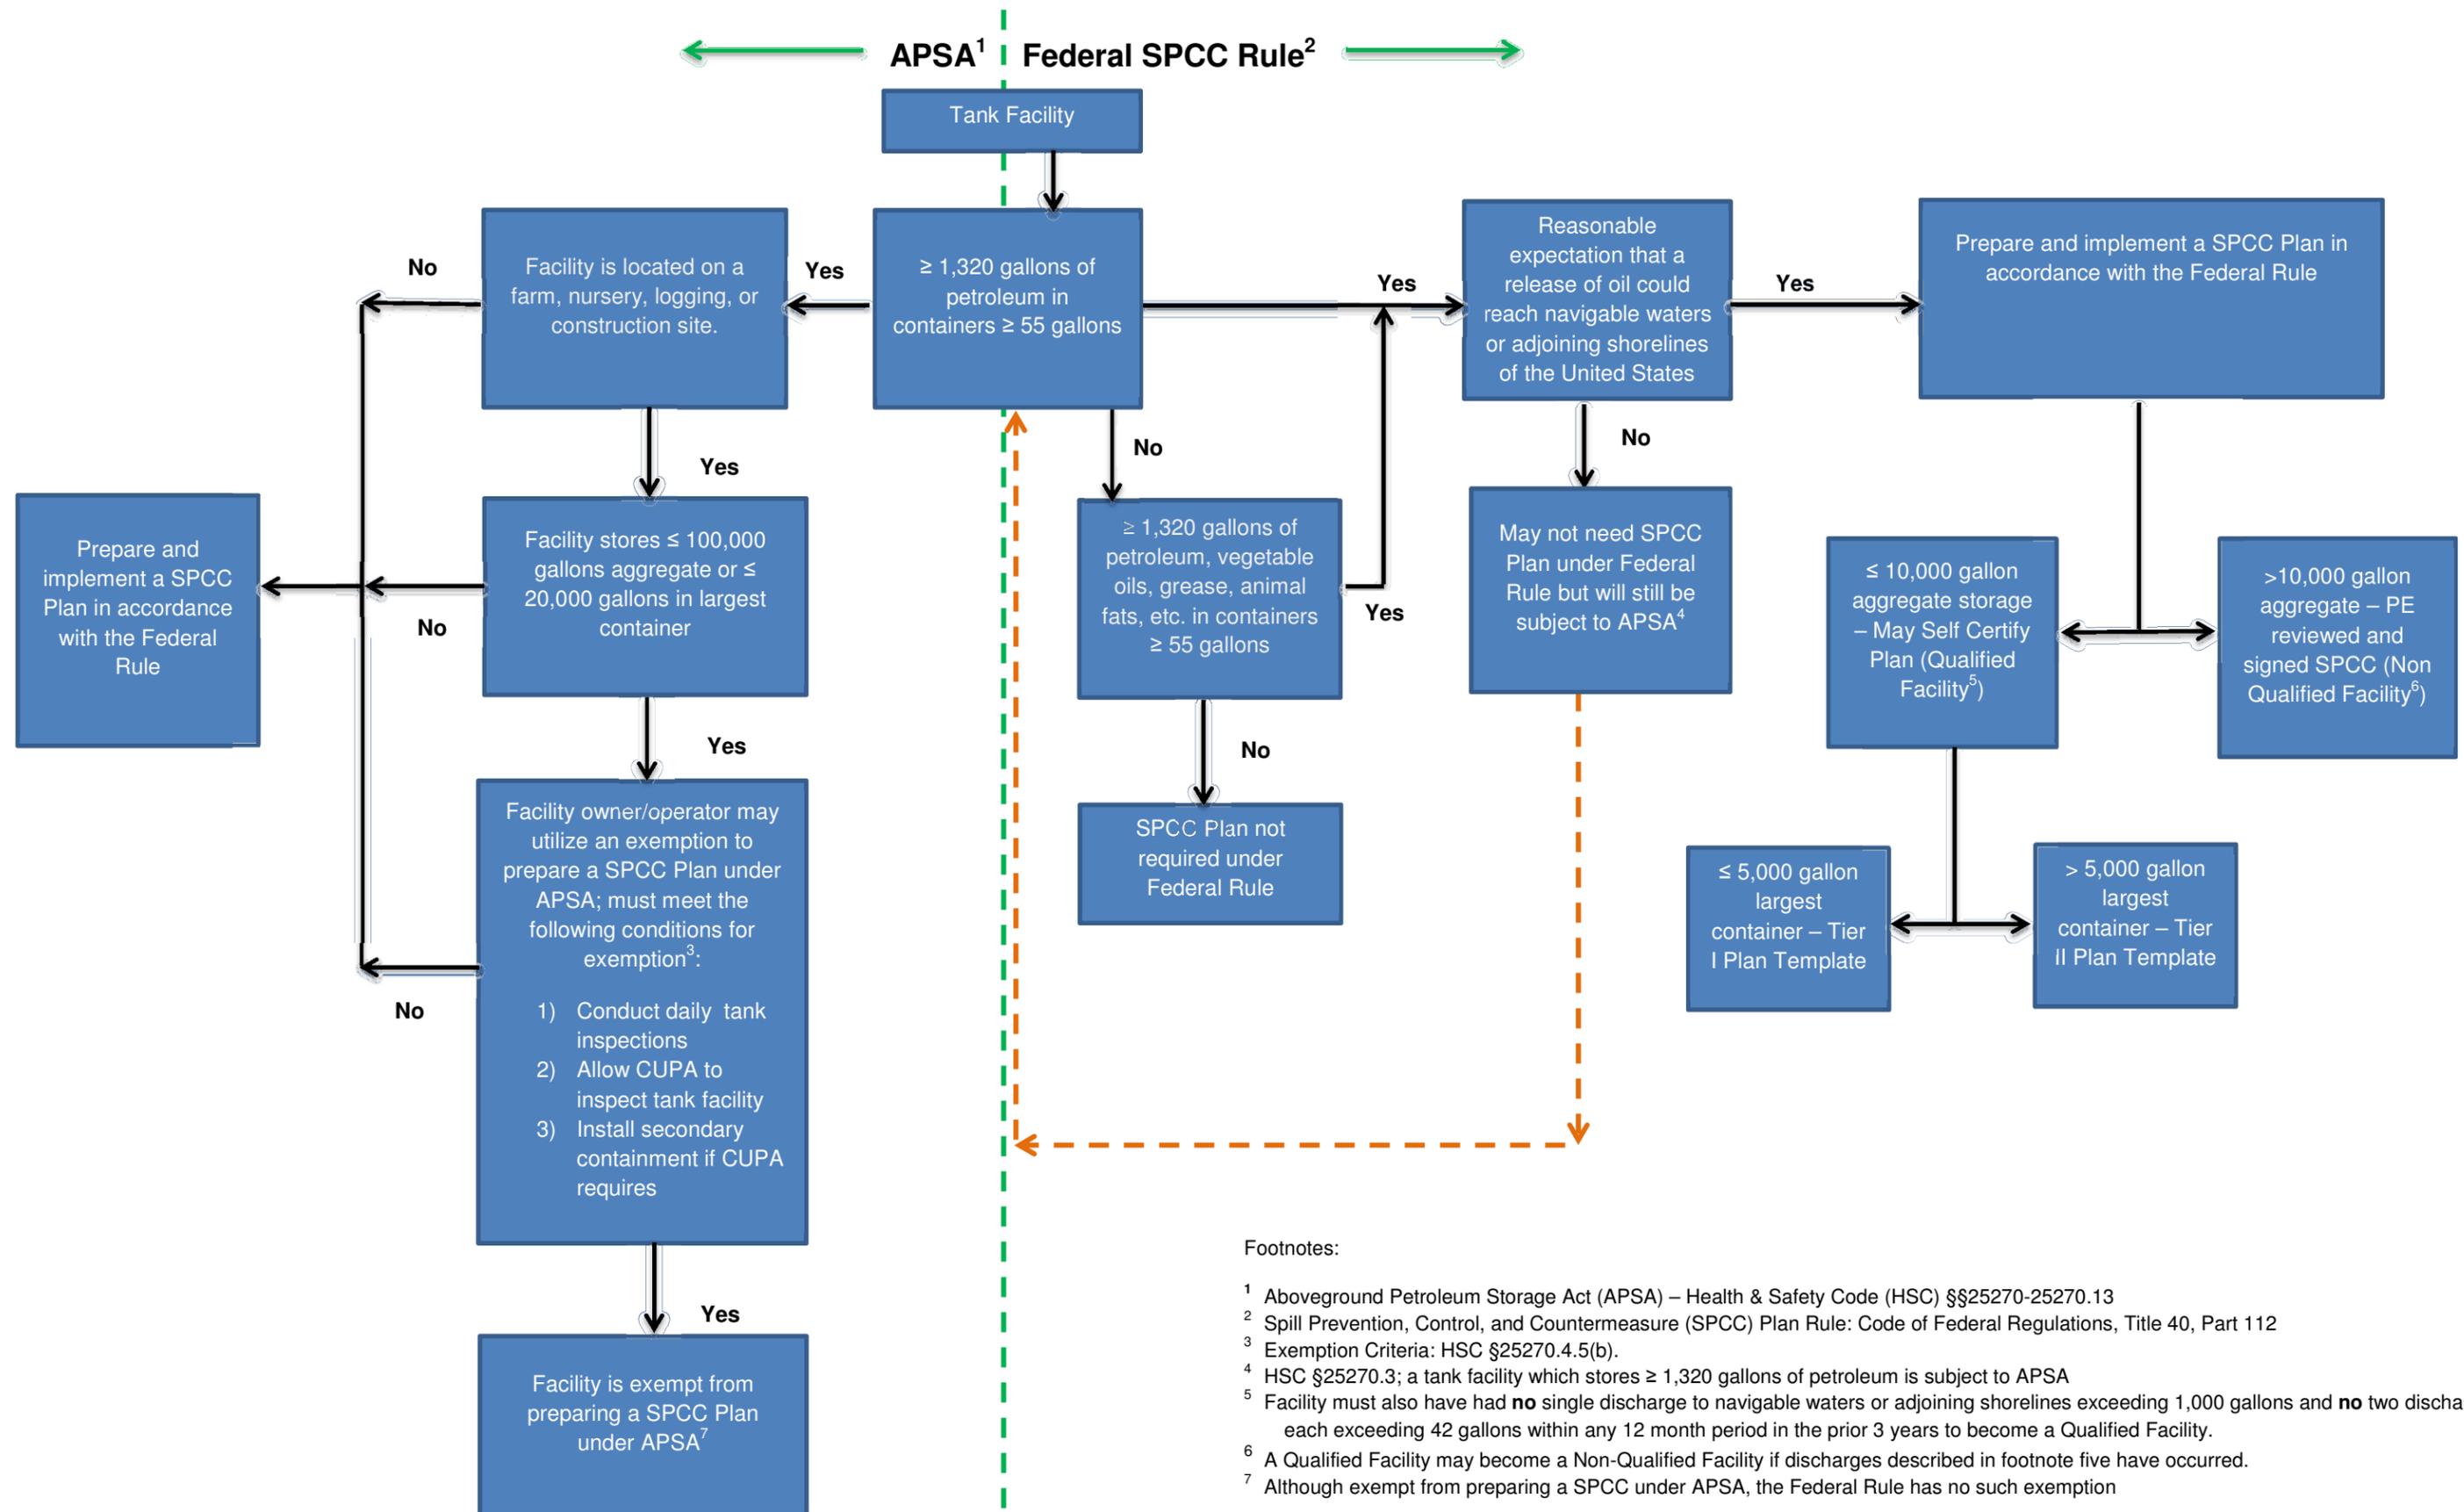

Footnotes:

- ¹ Aboveground Petroleum Storage Act (APSA) – Health & Safety Code (HSC) §§25270-25270.13
- ² Spill Prevention, Control, and Countermeasure (SPCC) Plan Rule: Code of Federal Regulations, Title 40, Part 112
- ³ Exemption Criteria: HSC §25270.4.5(b).
- ⁴ HSC §25270.3; a tank facility which stores ≥ 1,320 gallons of petroleum is subject to APSA
- ⁵ Facility must also have had **no** single discharge to navigable waters or adjoining shorelines exceeding 1,000 gallons and **no** two discharges each exceeding 42 gallons within any 12 month period in the prior 3 years to become a Qualified Facility.
- ⁶ A Qualified Facility may become a Non-Qualified Facility if discharges described in footnote five have occurred.
- ⁷ Although exempt from preparing a SPCC under APSA, the Federal Rule has no such exemption