GEOLOGIC MAP OF BUTTE COUNTY

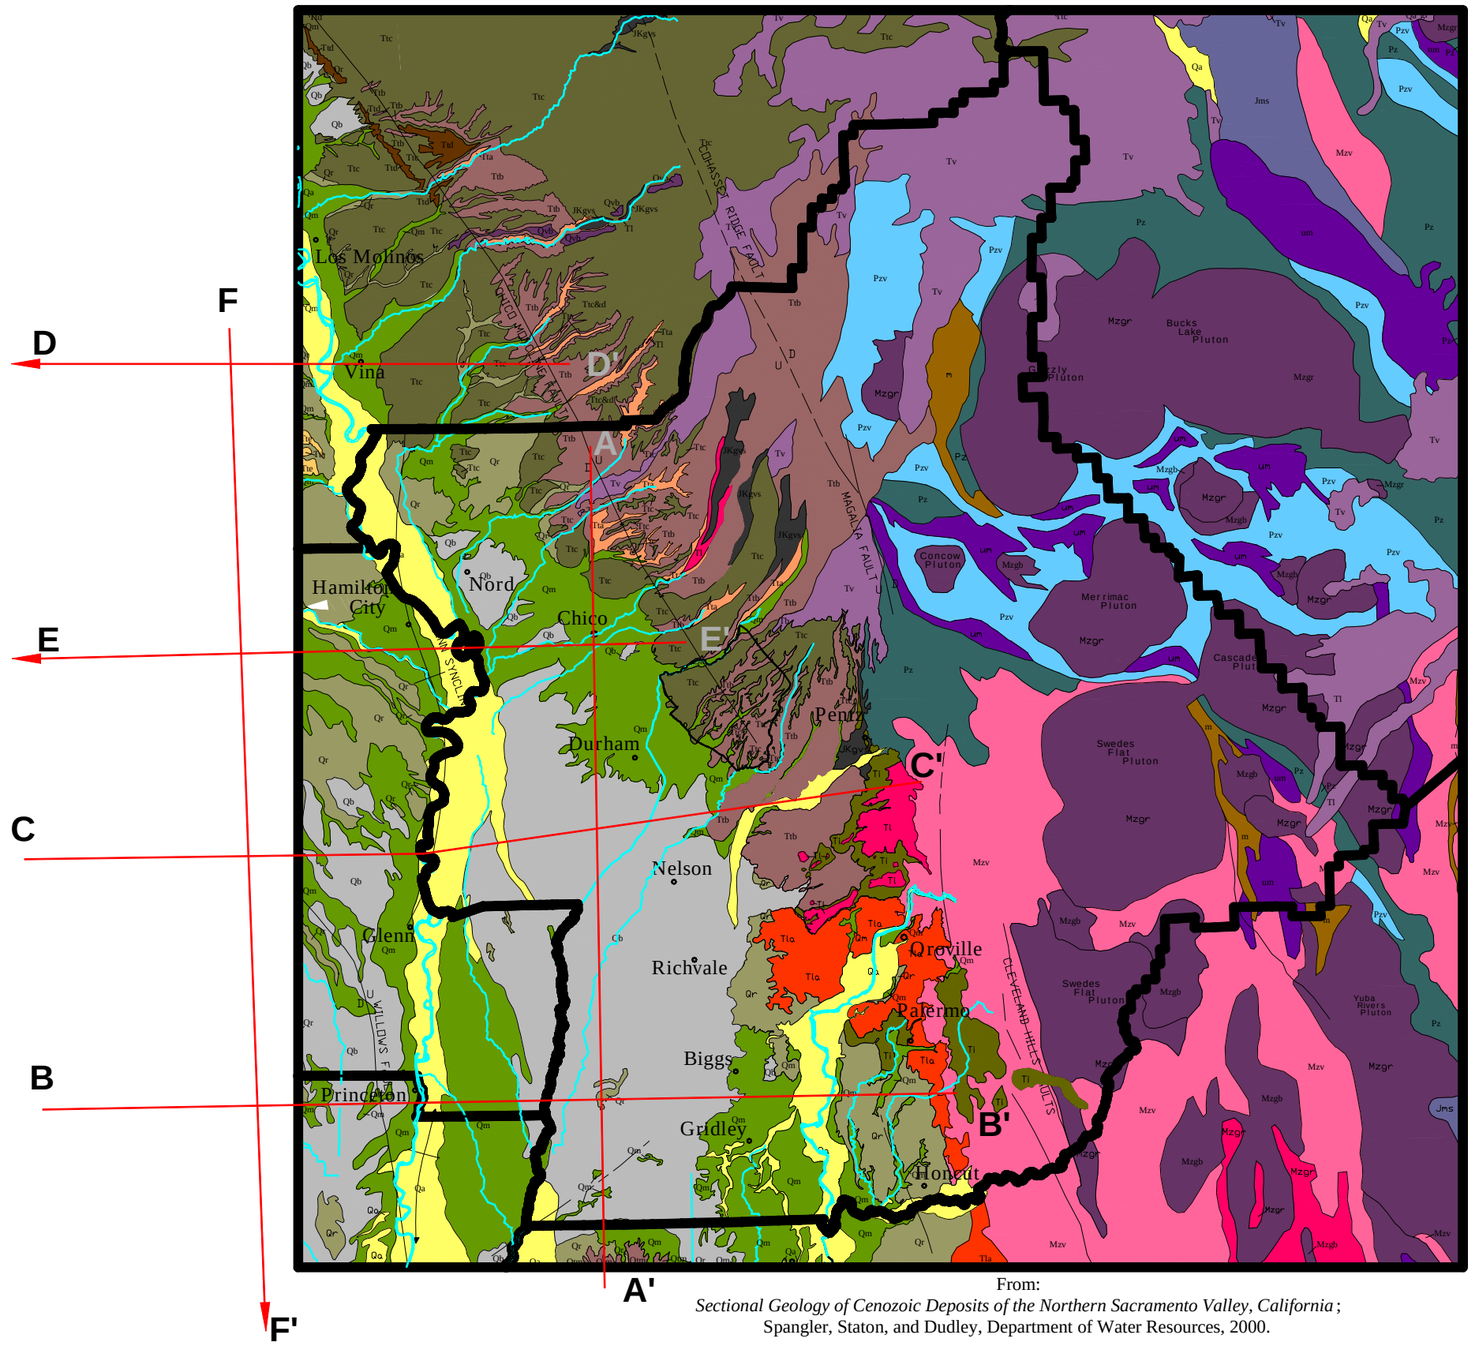

Map Legend

Fault - dashed where location is approximate; U indicates upthrown side and D indicates downthrown side.

Thrust Fault - dashed where location is approximate; barbs are on the upthrown side.

Anticline

Syncline

Base of Fresh Water-Base of fresh water was determined from electric log resistivity and represents a specific conductance of less than 3,000 micromhos per centimeter.

D D'

Location of Geologic Cross-Sections: Letters correspond to geologic sections shown in Plates 4 and 5. Arrows indicate that cross-section extends beyond the shown area.

5 0 5 10

MILES

From:
Sectional Geology of Cenozoic Deposits of the Northern Sacramento Valley, California;
Spangler, Staton, and Dudley, Department of Water Resources, 2000.

CDM Camp Dresser & McKee Inc.

Source: Department of Water Resources

Figure 2-3
Geologic Map of Butte County